


**HENRY PRODEQ SYSTEM
SEQUENCE OF INSTALLATION**

- ① DECK/SUBSTRATE AS SPECIFIED
- ② PRIMER (SEE NOTE #2)
- ③ WATERPROOFING MEMBRANE:
HENRY PRODEQ FX 400 (100 MILS)
- ④ COLOR STABLE TOP COAT:
4A - **HENRY GP TOPCOAT** (10 MILS)
4B - **HENRY GP TOPCOAT** (10 MILS)

NOTE: INSTALL OPTIONAL **HENRY GP TOPCOAT** AT AREAS EXPOSED TO INDEFINITE UV WHEN LONG-TERM COLOR STABILITY IS DESIRED.

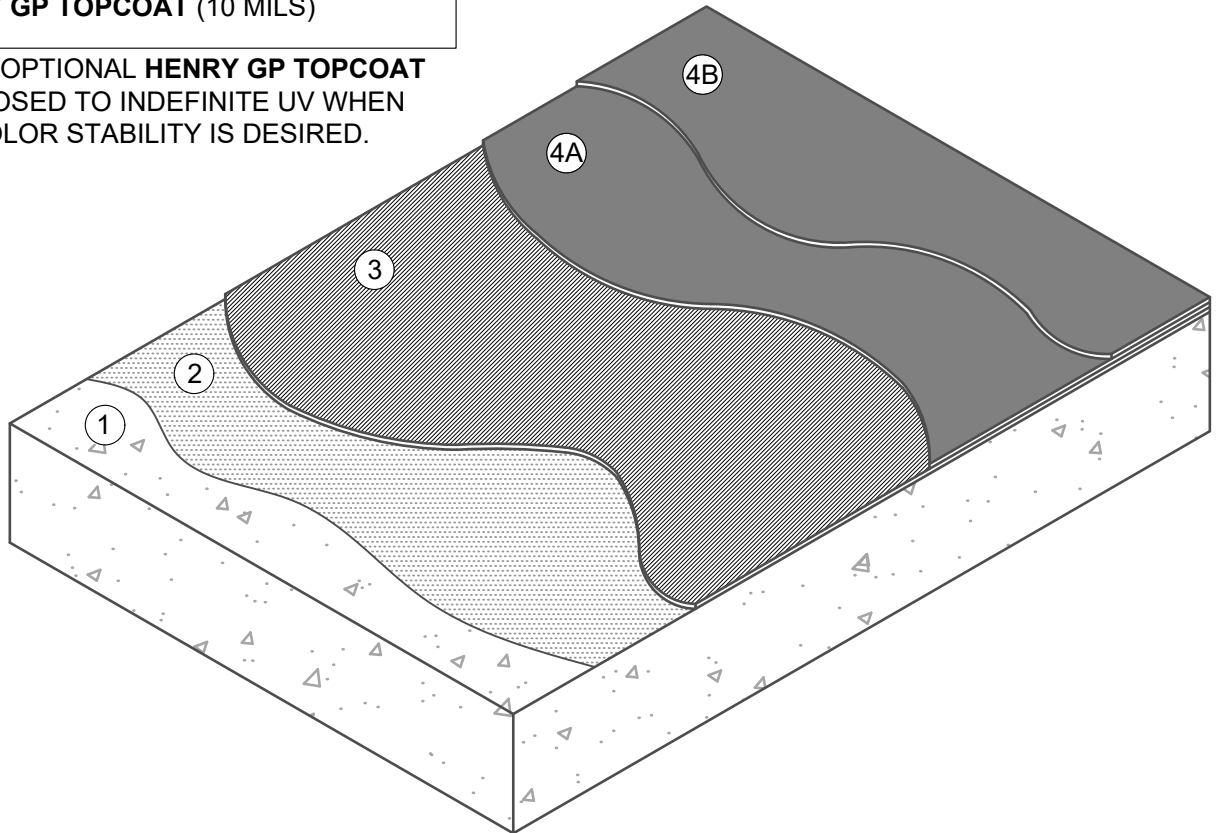

NOTES:

1. DETAIL SHOWS HENRY **PRODEQ** SYSTEM WATERPROOFING ASSEMBLY. SUBSTRATE SHOWN IS FOR REFERENCE ONLY. REFER TO PRODUCT SPECIFIC TECHNICAL DATA SHEET FOR AUTHORIZED SUBSTRATES.
2. THE STANDARD PRIMER FOR THE HENRY **PRODEQ** SYSTEM IS **HENRY ST PRIMER** WITH AGGREGATE. OTHER RECOMMENDED PRIMERS INCLUDE: **HENRY LV PRIMER**, **HENRY STXL PRIMER** WITH AGGREGATE, **PUMADEQ PRIMER 20** WITH AGGREGATE AND **HENRY GC EPOXY PRIMER**. REFER TO PRODUCT SPECIFIC DATA SHEET FOR PRODUCT SPECIFIC INFORMATION.
3. PREPARE AND PRIME VERTICAL SUBSTRATES A MINIMUM 2" (50MM) BEYOND **PRODEQ** SYSTEM APPLICATION IN ACCORDANCE WITH HENRY **PRODEQ** SYSTEM SUBSTRATE PREPARATION GUIDELINES TECH-TALK BULLETIN.
4. DO NOT INSTALL **PRODEQ** SYSTEM BEYOND PRIMED SURFACES.
5. HENRY OFFERS PAVERS, RIGID INSULATION, AND PREFABRICATED DRAINAGE COMPOSITES AS A SINGLE SOURCE WARRANTY OPTION PER PROJECT SPECIFIC REQUIREMENTS (NOT SHOWN FOR CLARITY). CONTACT HENRY FOR SYSTEM CONFIGURATIONS AND WARRANTY OPTIONS.
6. REFER TO **PRODEQ** SYSTEM GUIDE SPECIFICATION FOR RECOMMENDED INSTALLATION PROCEDURES.

Henry[®]

A **CARLISLE** COMPANY

999 N. Pacific Coast Highway, Suite 800
El Segundo, CA 90245
800-486-1278 • www.henry.com

MANUFACTURER GUIDE DETAILS ARE FOR REFERENCE ONLY. HENRY DOES NOT ASSUME RESPONSIBILITY FOR ERRORS OR DEVIATIONS IN DESIGN OR ENGINEERING. PROJECT SPECIFIC VERIFICATION IS RECOMMENDED PRIOR TO INSTALLATION.

PRODEQ SYSTEM - WATERPROOFING ASSEMBLY

SYSTEM DETAIL

**TYPICAL PRODEQ SYSTEM
WITH COLOR STABLE TOP COAT**

SCALE: N.T.S.

06-17-2022

PRODEQ-WB